

2000 Gallon Lift Station

Weight: 11,600 lbs.
Item # 1841

General Notes

Concrete Specifications:


- 1) 4000 psi after 28 days with 4%-6% air
- 2) Reinforcing is grade 60
- 3) Cover over pump chamber is not designed for vehicle loads.
- 4) All joints seal with butyl rubber joint sealant

Septic Tank Information:


- 1) Tanks should be pumped every 3-5 years
- 2) Center access cover and pump chamber cover should have risers to bring cover access close to grade.

Pump System Information:

- 1) Pumps are warranted for one year from date of installation.
- 2) System includes ACI Alarm Panel for mounting inside building.
- 3) Available with longer cable. Please specify length when ordering.

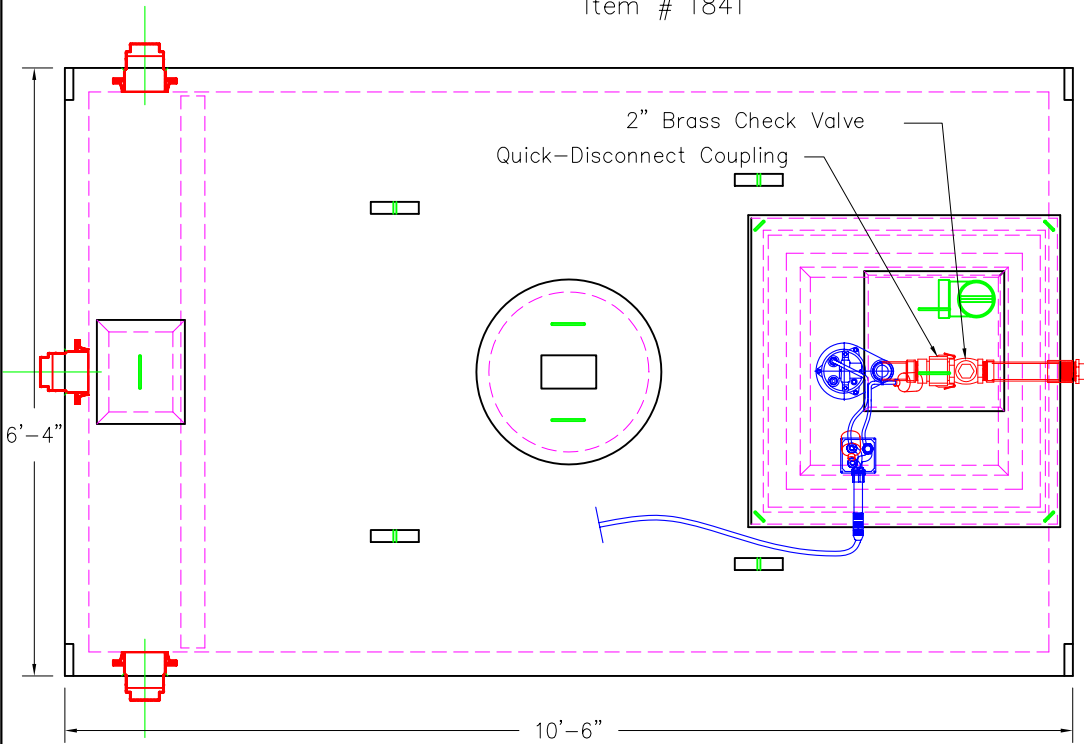

Plan View

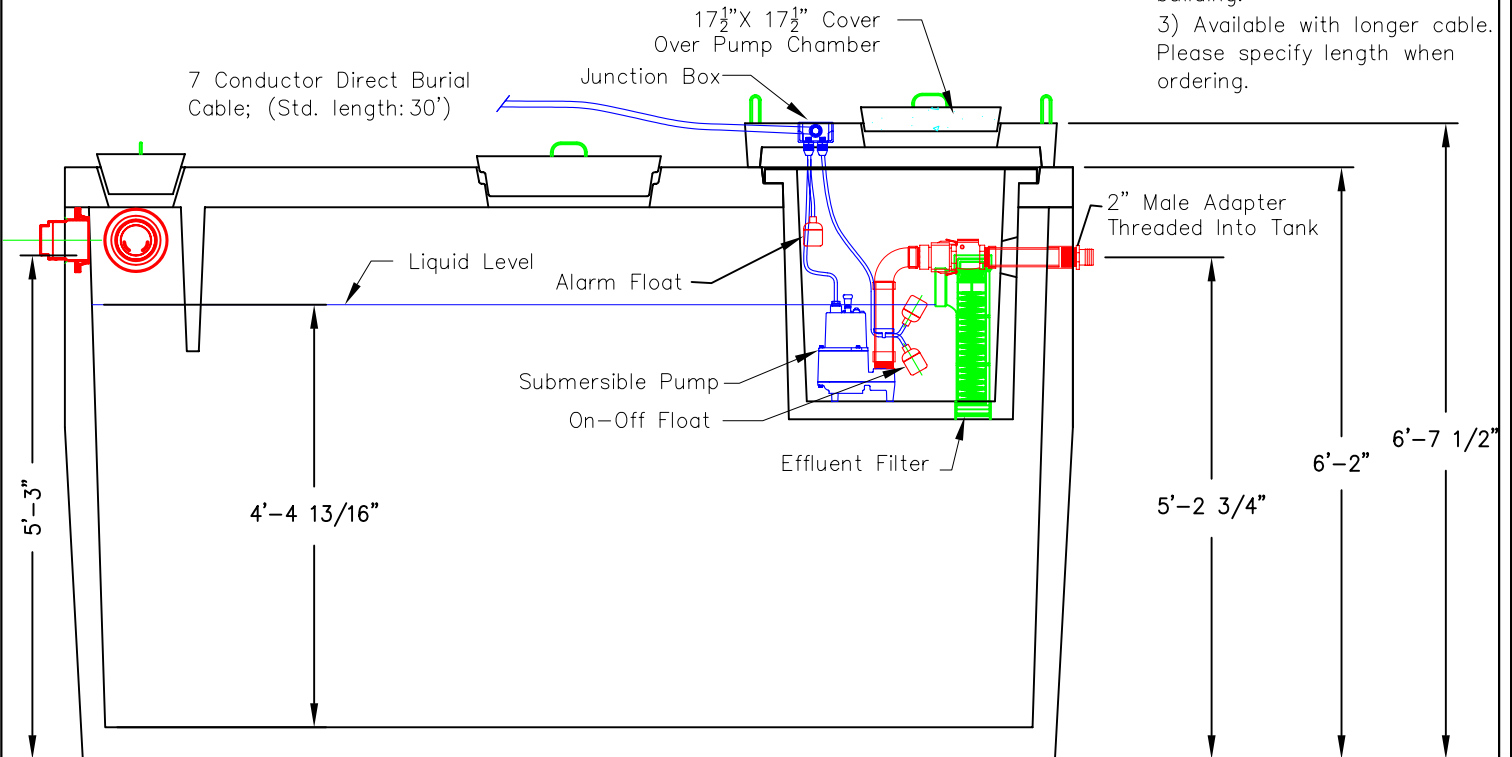

Section View

Item #	Pump Model
1841	Barnes EVH412
1843	Barnes STEP512SS
1844	Barnes STEP522SS
1845	Barnes STEP1022SS



American Concrete Industries

1022 Minot Ave. Auburn, ME / 1717 Stillwater Ave. Veazie, ME
Tel: 207-784-1388 / Tel: 207-947-8334

Last Revised:
01/06

PG. XXX